


* VALVE BOX CENTER SECTION AS REQUIRED

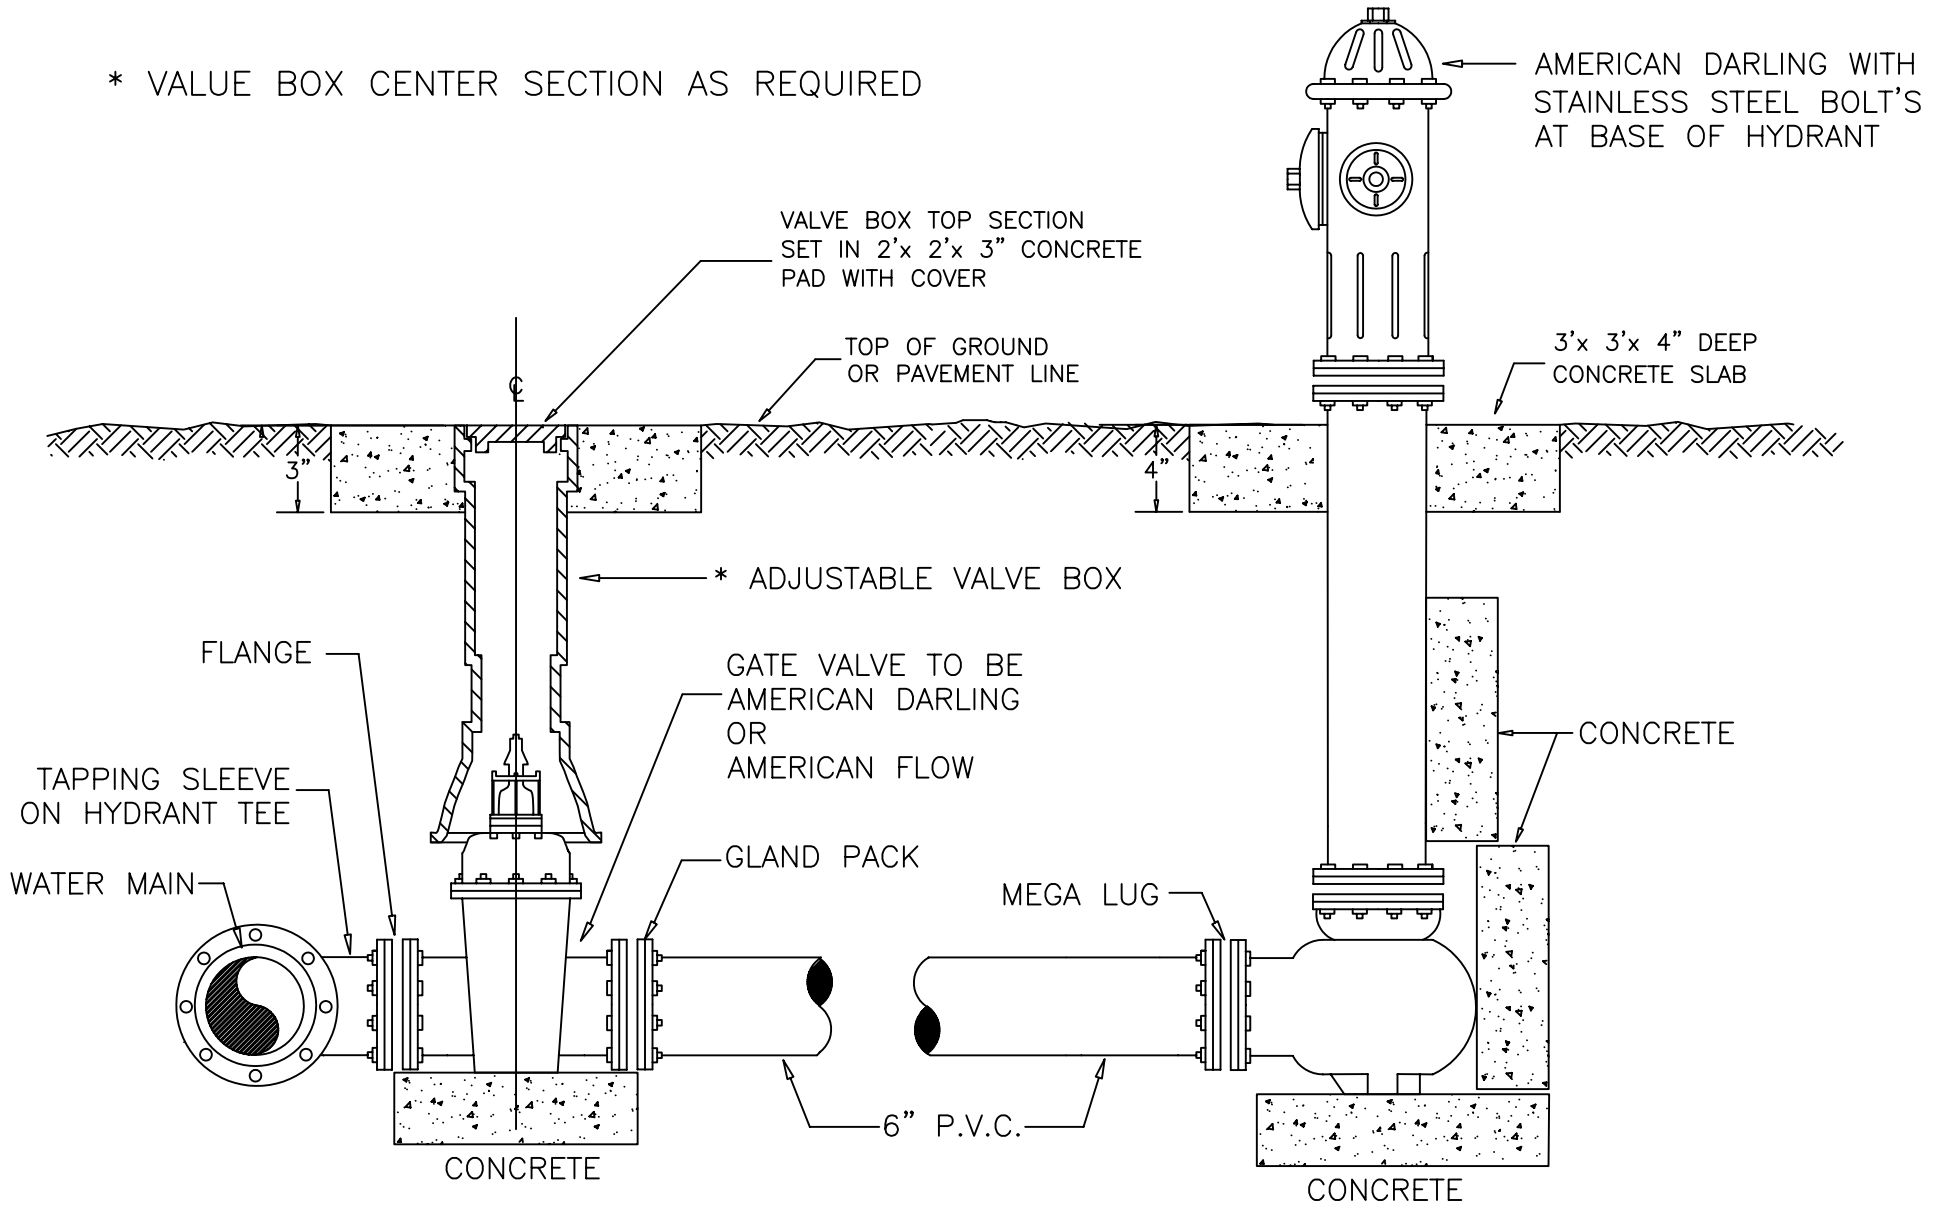

TYPICAL FIRE HYDRANT ASSEMBLY

N.T.S.