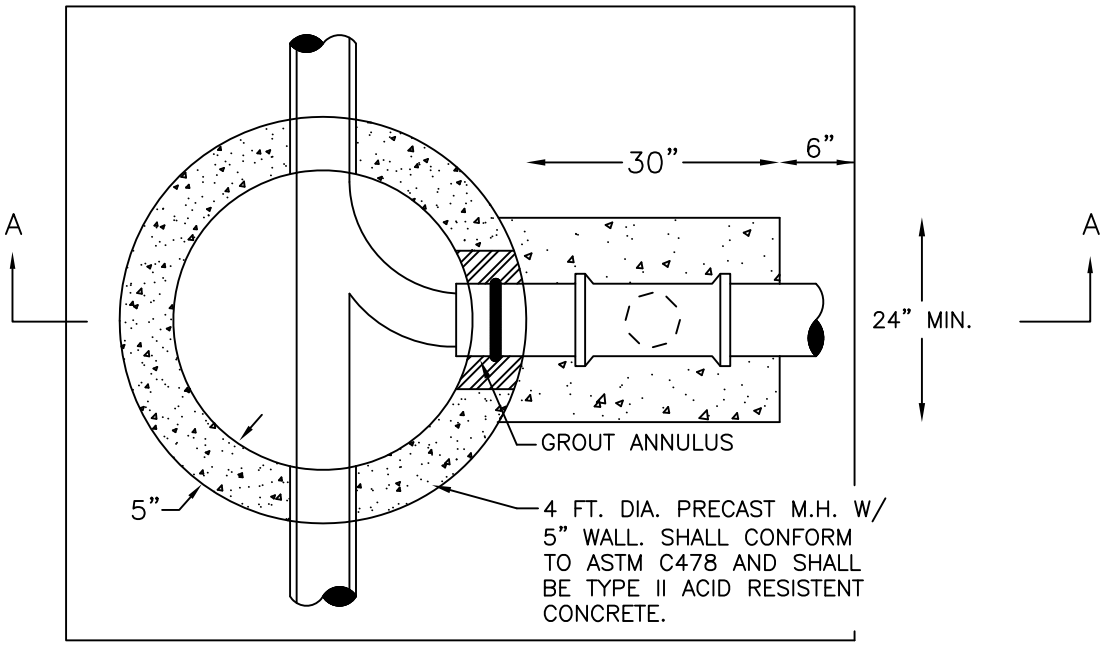

PLAN

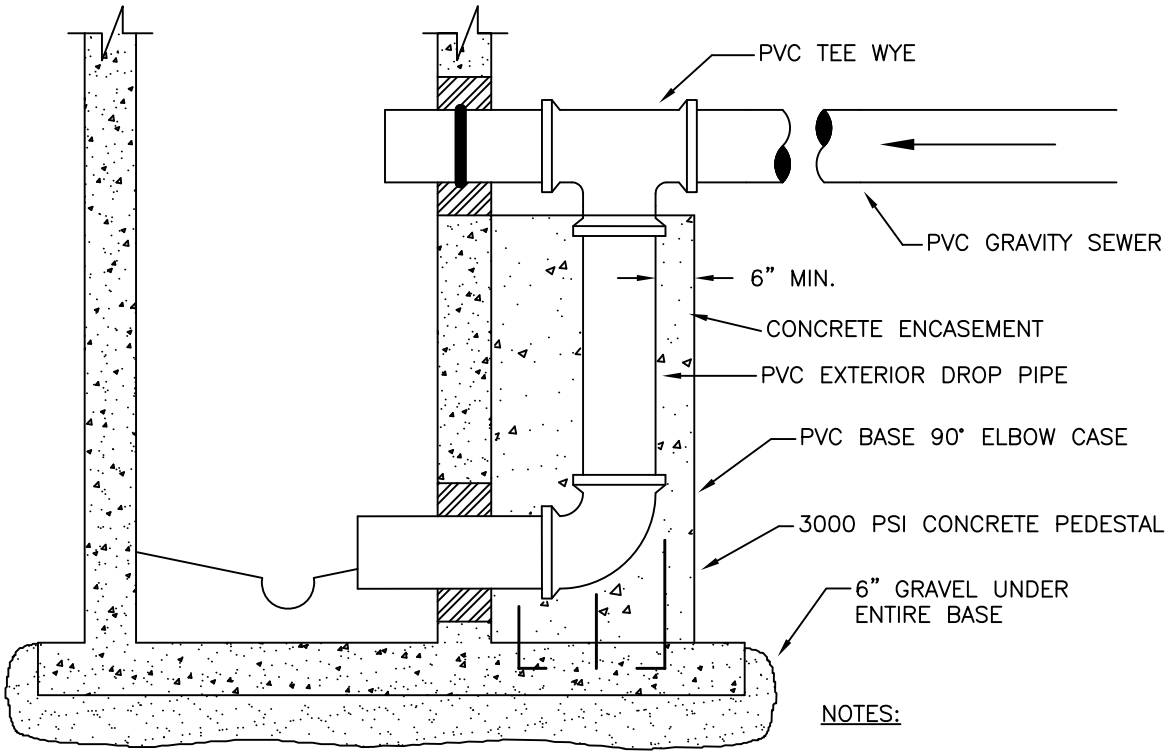

OUTSIDE DROP MANHOLE

NOTES:

1. MANHOLE TO BE CAST MONOLITHICALLY WITH EXTENDED SLAB TO SUPPORT CONCRETE ENCASEMENT OF BASE 90° FITTING. REINFORCING DOWELS SHALL EXTEND INTO CONCRETE FILL.
2. ALL PVC GRAVITY LINES PIPES ARE TO BE SDR–25.
3. NO INSIDE DROP MANHOLE ALLOWED.

LAST REVISION	NOV. 2017
CHECKED	KRL
APPROVED	PZ

DROP MANHOLE

ENGLEWOOD WATER DISTRICT
201 SELMA AVENUE
ENGLEWOOD, FLORIDA 34223